Govt. Pr.—27—40,006—16-12-32.

Law (1933) Department.

General

MS SERIES.

G.O. No. 876

DATED 10. 3. 33

[Despatch Abstract.]

Petroleum - B form licence - 15,000 gallons - Messrs. Nagar Rama Rao & Co., Udipi - South Kanara district - granted.

C.F. 30.

LAW (GENERAL) **DEPARTMENT.**

Received ..... 192 *Registered* G 1805 C 4.3.33 192

Subject.

Petroleum--dangerous--Storegge license in form B for 15,000 gallons--grant recommended.

ENCLOSURES.

No .....

.....

Spare copies .....

Ref.C. No. 308/M/33.

Station Camp: Kasaragod *Dated the* 1st March 1933. 192

From (Name) E. M. Gawne, Esq. I.C.S.,

(Designation) District Magistrate,

SOUTH KANARA.

To The Secretary to the Government of Madras,

LAW (GENERAL) Department.

Madras.

Sir,

I enclose herewith the application of Messrs. Nagar Rama Rao & Co. of Udipi for a license in form B for the storage of 15,000 gallons of dangerous petroleum in the shed constructed in S.No. 136/38 of Mudanidambur village, Udipi Town.

The applicants who are the Agents of the Western India Oil Distributing Co. Ltd. Bombay are reported by the Tahsildar to be all men of good status. The storage shed is also reported to be one which satisfies the conditions of the B. Form license applied for. The fee of Rs.60/- has been paid under chalian receipt No. 348 dated 10. 1. 33 of the Udipi Sub Treasury

P 7 infra

which is enclosed. I recommend the grant of a license.

Your obedient servant,

District Magistrate.

3

To 132

The District Magistrate, South Kanara,

M A N G A L O R E .

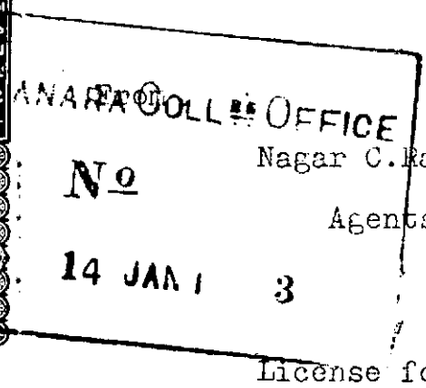

From

Nagar C.Rama Rao & Co.,

Agents, The Western India Oil Distributing Co.Ltd.
Bombay,

U D I P I. Dated 10th January 33.

License for Storage of Dangerous Petroleum 15000 gallons otherwise than in Bulk.

FORM B.

Sir,

We are appointed as Agents for selling Petrol in Udipi by The Western India Oil Distributing Company Ltd. of Bombay and also for storing Petrol here.

We have got a Petrol Shed constructed in S.N. 136/38 of Loodanidambur Village which can accomodate 15000 gallons of Packed Petrol as required under the Rules.

We have enclosed herewith Treasury Chalan receipt No.348/10-1-1933 for Rs 60/- being the license fee on 15000 gallons.

We therefore pray that the said Shed may kindly be inspected early and the licence be granted to us as early as possible.

The sketch of the Plot and the Shed has been attached herewith for kind perusal.

We beg to remain,

Sir,

Your most obedient and faithful servants

For Nagar C. Rama Rao & Co

C Rama Rao

ENCLO:-TWO only (2 only)

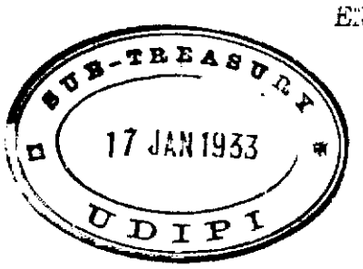

Dy. for local Inspection of the shed 24.1.33

D1-671-33

N Rly-C-338/m/33

Forwarded to the Tahsildar of Udipi for very early report on the status of the applicants & also whether the Storage Shed satisfies the conditions of the license.

for DC Kasaba

V
Nos 671-33 4

Resubmitted

Magistrate

Sub Inspector (Court of Wards)
South Kanara
(Conductor)

2. The ~~[illegible]~~ members of the company are all men of ~~[illegible]~~ family & good status as would appear from the statement & details of Lakshmi an account of which I enclose. The cost of ~~[illegible]~~ shed is of corrugated iron resting on wooden rafters The floor is cement & is ~~[illegible]~~ of the compound but below this surface, outside The walls are of laterite. The windows are protected by iron railing. There is no provision vacant shed left on the ~~[illegible]~~ Sub Inspector

16. 2. 33

Inspector

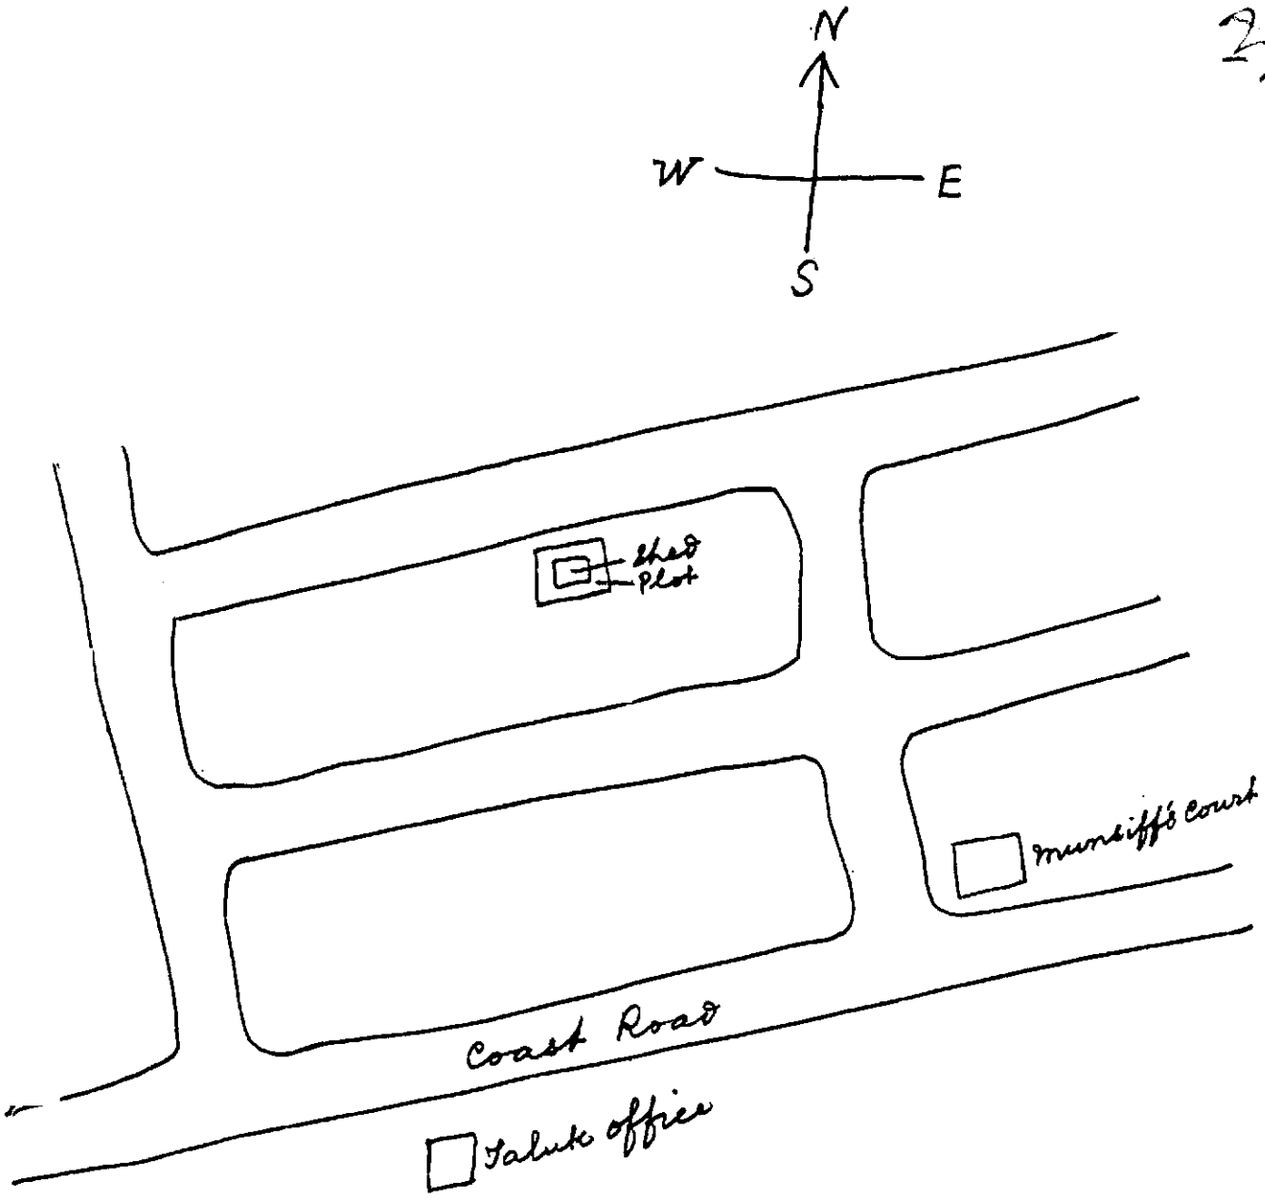
N
W
E
S
shed plot
munsiff's court
Coast Road
Taluk office

65

Statement made by
Lakshminarayana Nayak
son of the late P. Nagappa
Nayak before Sabhapati
Iyer on 16.2.33

The company for storing &
dealing in Betel at Erode styled
Messrs Nagan C.Ramakrishna
Co. consists of Messrs C.Ramakrishna,
P. Janardhana Nayak & myself.
Mr. C.Ramakrishna is now absent in
Nagpur dispute Province. The
pays an assessment of
Rs 2500 during Nagpur
assessment of Rs 1800 on
Timebonds P. Janardhana
Nayak is my cousin. Mr.
C.Ramakrishna has married my
sister

Bangal Lakshminarayana Nayak.

Taken down by me, read over
to the deponent & declared
correct

Sabhapati Iyer
Jahgirdar

R. F. XXXII-1.—66,564—20-8-30.

R.F. XXXII 1.

"The receipt is not binding or valid on Government unless it is signed (1) by the shroff and (2) by the Taluk Hd. Acctt. or Taluk Sarishtadar."

"(1) ಸರಾಫನಿಂದಾ - ವ - (2) ತಾಲೂಕು ಹೆಡ್ ಎಕ್ಕೌಂಟಾಂಟ - ಯಾ - ತಾಲೂಕು ಶಿರಸ್ತೇದಾರರಿಂದಾ ನಸ್ಕತು ಆದ ವಿನಃ ಈ ರಶೀದಿಯು ಗವರ್ನಮೆಂಟಿನವರಮೇಲೆ ಬದ್ಧೀಕರಿಸತಕ್ಕದ್ದಲ್ಲಾ - ವ - ಸಿಂದುವಲ್ಲಾ."

Chalan for payment of money into the Sub-Treasury at Udipi

ಸಬ್ ಟ್ರೆಜರಿಯಲ್ಲಿ ಹಣ ಪಾವತಿಮಾಡಿದಬಗ್ಗೆ ಜಲನ್ ಯಾನೆ ಪವೇ ಚೀಟು.

No. 348
ನಂಬ್ರ

SUB-TREASURY
10 JAN 1933
UDIPI

By whom paid. ಯಾರಿಂದಾ ಪಾವತಿಮಾಡಿದ್ದು.	On what account. ಯಾವ ಬಗ್ಗೆ.	Amount. ಮೊಬಲಗು.			Monthly consecutive No. assigned to the credit in the day-book. ಈ ಜಮೆಯಿನಲ್ಲಿ ಜಮೆ ಖತ್ಯಾತಿಗೆ ಕೊಡೋಣಾದ ತಿಂಗಳಗಟ್ಟಿಲ ಜಂಜರಿ ನಂಬ್ರ.	
		Rs. ರೂ.	A. ಆ.	P. ಪೈ	No. ನಂಬ್ರ.	Month. ತಿಂಗಳು.
Nagar C. Rama Rao	License fee for storage of Dangerous Petroleum 15000 gallons	60	0	0		
Date ತಾ. 10-1-'33	TOTAL (in words and figures). ಜುಮಲಾ (ಅಕ್ಷರಗಳಲ್ಲಿ - ವ - ಅಂಕೆಗಳಲ್ಲಿ). Rupees sixty only	60	0	0		

Signature of Remitter.
ಹಣ ಕಳುಹಿಸಿದವನ ದಸ್ಕತು. for Ramabhag

Received Rupees (60—)
ಜಮಾ ರೂಪಾಯಿ

Sub-Treasury, ಸಬ್ ಟ್ರೆಜರಿ, 1933
The ತಾ. 19

Entered.
ಜಮೆಕ್ಕೆ ದಾಖಲುಮಾಡಲಾಯಿತು.

Shroff ಸರಾಫ್.

Taluk Hd. Acctt or Taluk Sarishtadar.
ತಾಲೂಕು ಹೆಡ್ ಎಕ್ಕೌಂಟಾಂಟ ಅಥವಾ ತಾಲೂಕು ಶಿರಸ್ತೇದಾರ

Particulars of money paid.

ಪಾವತಿಸಿದ ಹಣದ ವಿವರಗಳು.

Currency Notes.
ಕರೆನ್ಸಿ ನೋಟುಗಳು.

Rs. 1,000	ರೂ.	..
,, 500		..
,, 100		..
,, 50		..
,, 20		..
,, 10		..
,, 5		..
,, 2½		..
,, 1		..
	Total Notes	..
	ಒಟ್ಟು ನೋಟುಗಳು	

Cash. ನಗದು.

Sovereigns, Full.	ಇಡೀ ಸೌವರಿನ್ಸ್
,, Half.	ಅರ್ಧ ಸೌವರಿನ್ಸ್
Whole Rupees.	ಇಡೀ ರೂಪಾಯಿ
½ Rupees.	ರೂಪಾಯಿಗಳು
¼ ,,	,,
⅛ ,,	,, ..
Eight anna nickel.	ಎಂಟಾಣೆ ನಿಕ್ಕಲ್
Four ,, ,,	ನಾಲ್ಕಾಣೆ
Two ,, ,,	ಎರಡಾಣೆ
One ,, ,,	ಒಂದಾಣೆ
Double pice.	ದಿವಾಣಿಗಳು
Single pice.	ಪಾವಾಣಿಗಳು
Pies.	ಪೈಗಳು ..
	Grand Total ..
	ಒಟ್ಟು ಜಮೆಲಾ.

Secty. 11-5 (a

Law (Genl) DEPARTMENT.

	Date.	Initials.
When received for Fair-copying.		
When copied ..		
When examined ..		
When signed ..		
When despatched ..		

Petroleum B. form licence - 15.000 gallons - Messrs. Nagar Rama Rao & Co. Udipi - South Kanara Dt. granted.

GG

READ AGAIN G.O. No. 1093, dated 19

" " " ..... " 19

READ ALSO :—

P.C. No. 1805C From the D. M. South Kanara Ref.c. No. 338/11/33 dated 1.3. 1933

" " ..... " " ..... " 19

" " ..... " " ..... " 19

ORDER.

MS

No. 876, dated 10.3. 1933

for proc. to vide fo 152 at G

A licence in form B of the Petroleum Rules will be issued to Messrs. Nagar Rama Rao & Co., Udipi Agents for Western India Oil Installation Co. Ltd. for the storage of 15,000/- (fifteen thousand) gallons of dangerous petroleum otherwise than in bulk in their storage shed constructed in S. No. 136/38 of Mudanidambur, Udipi town, South Kanara Dt.

2 The licences will be forwarded to the D.M., South Kanara, for delivery to them from

Vau Upd. by Regd. Post. ... ager

Upd ... to Col 11/3/33.

Date

To the D.M. South Kanara (with licence)

" Dispatcher of Petroleum in India (with copy of licence)

" Messrs. Nagar Rama Rao & Co. Udipi.

SM 8/3/33 SVD 8/3

BB 9/3

Lwo 10/3/33

S

PTO

(H.E. Rule I Chapter IV . Part-II)

Form B.

(Rule 3 of Chapter IV of Part II.)

License to possess dangerous petroleum, otherwise than in bulk, in quantity exceeding forty gallons.

No. Fee, Rs. 60/- (sixty only)

License is hereby granted to Messrs. Nagar Rama Rao & Co. Udipi for the storage, in the storage shed described below, of 15,000/- (fifteen thousand) gallons of dangerous petroleum, subject to the rules for the storage of petroleum published in Notification No. 441, dated 24th July 1909 and to the further conditions on the back of this license.

C/C
10/3/33.
Secretary to the Government of Madras.

for Secy. George

The March 1933.

(Description of the storage shed above referred to.)

The storage shed is ~~at~~ situated in S.No. 136/38 of Mudanidambur village, Udipi town in the district of South Kanara

M
7/3/33
8/3

10/3/33.

Endorsement on Form B.

CONDITIONS OF LICENSE.

1. If the licensing officer call upon the holder of a license, by notice in writing, to execute any repairs of the storage shed, which may, in the opinion of such officer, be necessary for the safety of the shed, the holder of the license shall execute the repairs within such period, not being less than one month from the date of receipt of the notice, as may be fixed by the notice.

2. The license-holder is prohibited from delivering any quantity of dangerous petroleum exceeding three gallons to any one who has not a license under section 5 or section 6 of the Act, or any less quantity of such petroleum, except in accordance with the conditions of the proviso to section 6 of the Act, as to the vessels in which the petroleum must be contained.

3. The petroleum shall be stored in gas-tight tinned or galvanized sheet iron, steel, or lead plate receptacles containing each not more than forty gallons and fitted with well-made filling holes and well-fitting screw plugs, or fitted with screw cap or other cap with metal air-tight undercap. Such receptacles shall be packed in strong wooden cases, the thickness of the wood to be not less than three-eighths of an inch; provided that wood cases shall not be necessary when the receptacles are made of tinned or galvanized sheet iron or steel, and have the following thickness of metal:—

	Not less than
(1) When the capacity does not exceed two gallons	27 B.W.G.
(2) When the capacity exceeds two, but does not exceed five gallons	24
(3) When the capacity exceeds five, but does not exceed thirty gallons	18
(4) When the capacity exceeds thirty but does not exceed forty-five gallons	17
(5) When the capacity exceeds forty-five, but does not exceed sixty-five gallons	16

(6

4. An air-space of at least one-~~tenth~~ of its capacity shall be left in each receptacle at the time of filling.

5. The receptacle shall be so substantially constructed and secured as not to be liable except, under circumstances of grave negligence or extraordinary accident, to be broken or become defective, leaky or insecure.

6. The receptacles shall be labelled in accordance with the provisions of section 7 of the Act.

7. Any receptacle, before being repaired, shall be cleared of all dangerous petroleum and of all dangerous vapours arising from the same.

8. The storage shed shall be constructed of masonry or other uninflammable material with terraced, tiled or iron roofs and with tiled or paved or earthen floors.

9. Either the doorways and other openings of the storage shed shall be built up to a height of two feet above the level of the road or street, or the floor sunk to a depth of two feet below the level of the road or street, so that the petroleum cannot flow out from the building in case of its escape from the receptacle in which it is contained, or the building itself shall be surrounded with a masonry wall or embankment or both not less than two feet high. When the quantity of petroleum stored exceeds 16,000 gallons the height or depth shall be three feet.

A combination of these methods is permissible.

10. All ventilating openings in the storage shed shall be protected by strong wire gauze.

11. No light, except a light of such strength, position and character as is not liable to ignite any inflammable vapour, nor fire of any description, shall be permitted at any time within the storage shed.

12. All due precautions shall be taken for the prevention of unauthorised persons having access to any dangerous petroleum kept and to the vessels containing or having actually contained the same.

13. Every person managing or employed on or in connection with the storage shed shall abstain from any act whatever which tends to cause fire or explosion and which is not reasonably necessary, and shall prevent any other person from doing such act.

14. The drum or other receptacle containing dangerous petroleum shall only be opened on the licensed premises at or immediately adjoining the storage shed and for the time necessary for drawing off the petroleum, and during such drawing off every reasonable precaution shall be adopted for preventing the escape of dangerous petroleum or the vapour therefrom.

15. The following distances shall be kept clear from protected works round the storage shed :—

Quantity to be stored	Distances to be kept clear
Not exceeding 500 gallons	20 feet.
From 500 to 1,000 „	25 „
„ 1,000 to 5,000 „	30 „
„ 5,000 to 15,000 „	40 „
„ 15,000 to 25,000 „	50 „
„ 25,000 to 35,000 „	60 „
„ 35,000 to 50,000 „	70 „
„ 50,000 and over „	100 „

Provided that these distances may be reduced by the Local Government on the recommendation of the Chief Inspector of Expolsives in cases where screen walls are provided or other special precautions taken, or where there are special circumstances that in the opinion of the Chief Inspector of Explosives warrant the reduction.

16. Provided that when the quantity to be possessed does not exceed 60 gallons the provisions of conditions 8, 9 and 15 shall not apply, but the licensee shall observe the following conditions :—

(i) The storage shed in which the dangerous petroleum is stored shall be well ventilated and constructed of uninflammable material, provided however that the doors and windows may be of wood.

(ii) Where a storage shed forms part of or is attached to another building and when the intervening floor or partition is of an unsubstantial or inflammable character or has openings therein, the whole of such building shall be deemed to be the storage shed and no portion of such storage shed shall be used as a dwelling house or as a place where persons assemble. The storage shed shall have a separate entrance from the open air distinct from any building or dwelling in which persons assemble.

17. The storage shed shall be liable to inspection by an officer not being on lower rank than a Sub-Inspector of Police authorised by the Governor in Council in this behalf.